




KING CITY
CALIFORNIA

**BUILDING DEPARTMENT
INFORMATIONAL HANDOUT #26**


COMBUSTION AIR REQUIREMENTS

NOTE: Shaft surrounding vent may be used as upper combustion air duct, provided it is of the proper area.

FIRE DAMPERS ARE NOT PERMITTED IN COMBUSTION AIR OPENING

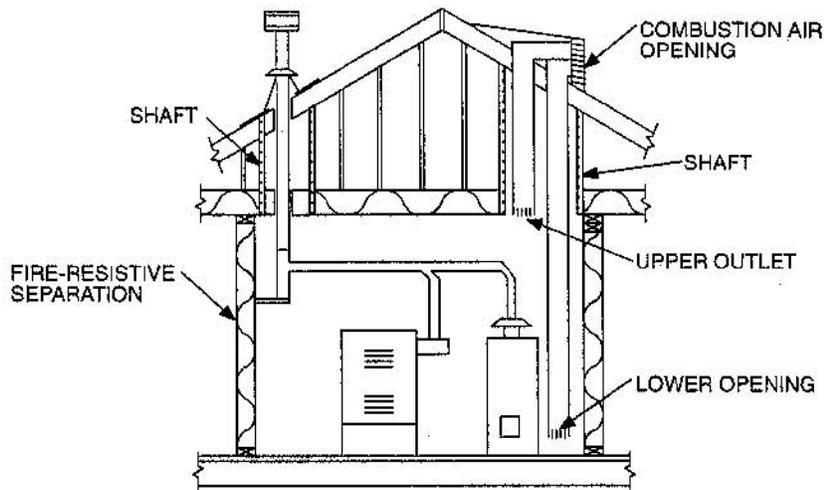

COMBUSTION AIR OPENING SHALL BE COVERED WITH 1/4 IN. (6.4 mm) SCREEN.

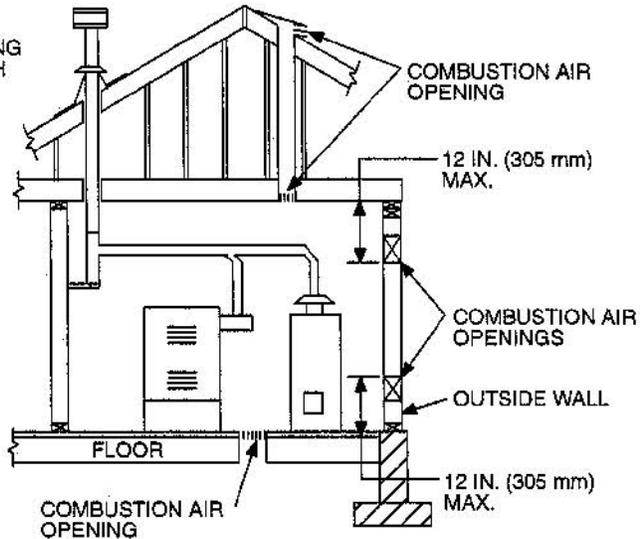

SEE CALIFORNIA MECHANICAL CODE CHAPTER 7