




KING CITY
CALIFORNIA

**BUILDING DEPARTMENT
INFORMATIONAL HANDOUT #31**

**ELECTRIC SERVICE GROUNDING “UFER” REQUIREMENTS
(California Electrical Code Article 250-50 (C))**

**Overhead or Underground Service
“UFER” Grounding Method
Concrete Encased Electrode**

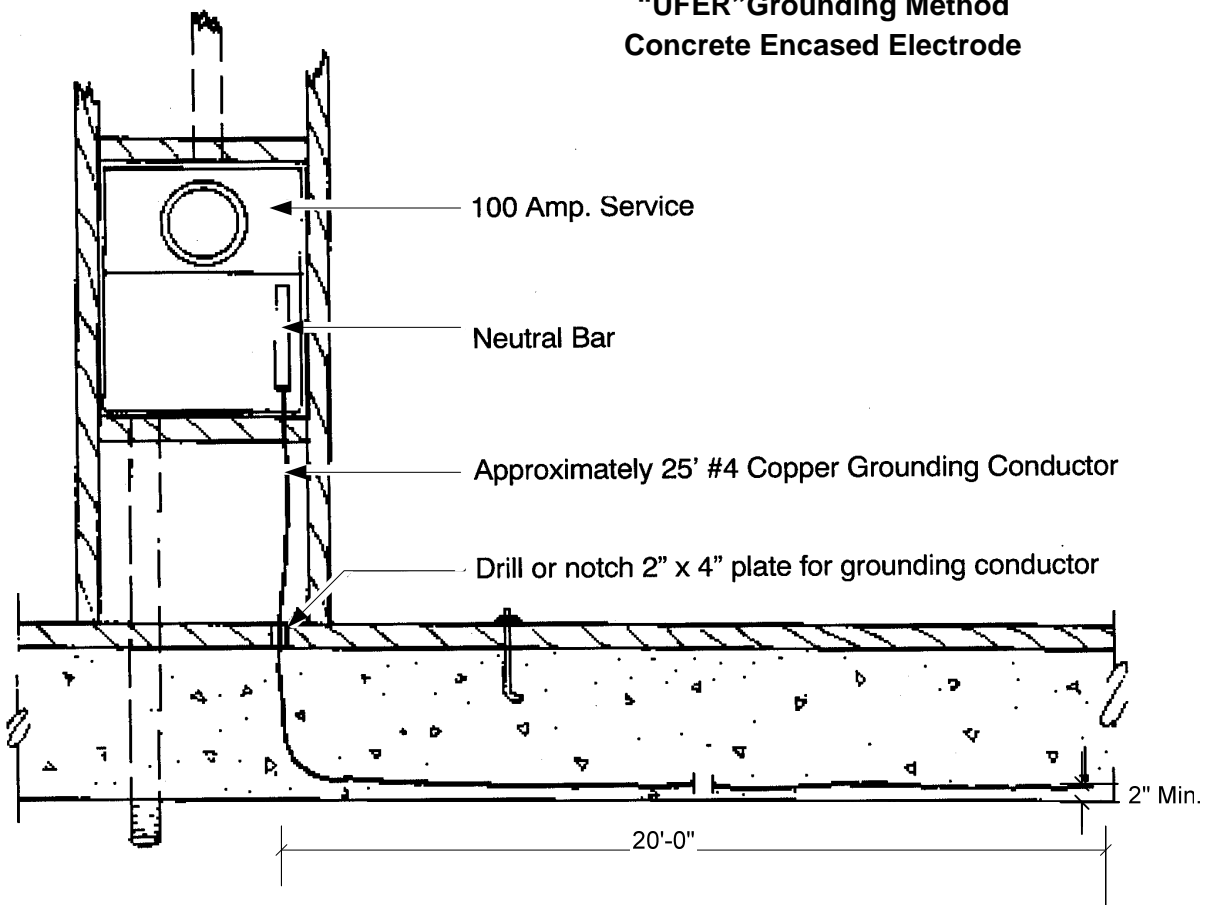

NOTE:

Provide minimum size #8 copper bonding jumper from service neutral bar to cold water pipe with approved type ground clamp in an accessible location; for all methods of grounding.